




CUPERTINO SANITARY DISTRICT

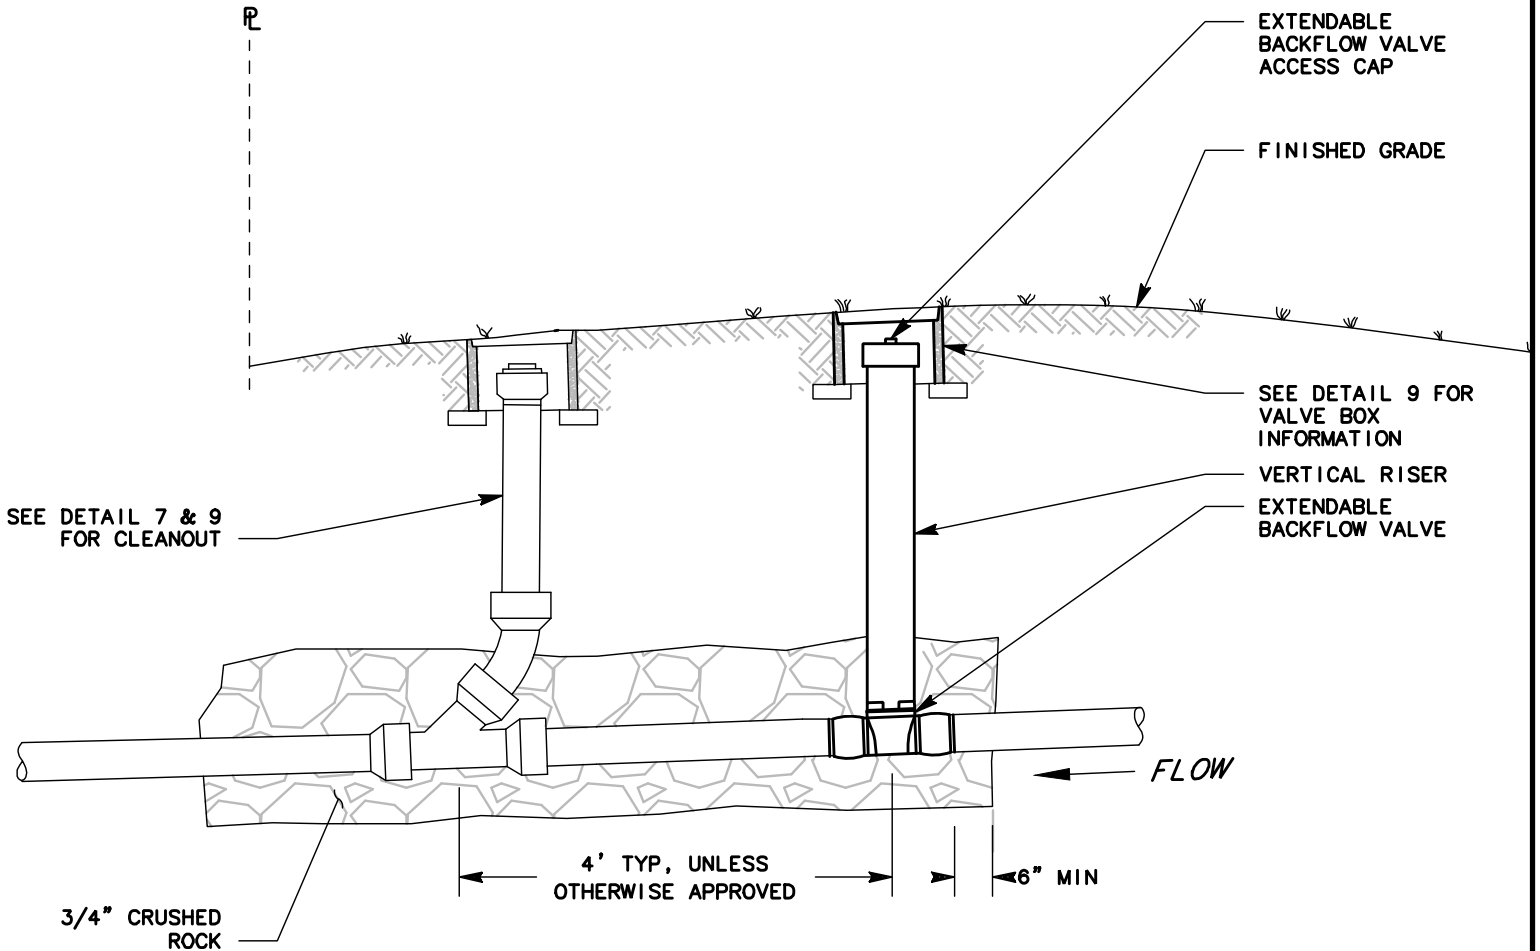

NOTES:

1. A BACKFLOW PREVENTER DEVICE IS REQUIRED WHEN THE ELEVATION OF THE LOWEST FINISHED FLOOR WITH PLUMBING IS LESS THAN 12" ABOVE THE NEAREST UPSTREAM MANHOLE OR FLUSHING INLET
2. ALL CLEANOUTS AND BACKFLOW DEVICES ARE TO BE MAINTAINED BY PROPERTY OWNER
3. ALL BACKFLOW DEVICES ARE TO BE ACCESSIBLE FOR LATERAL SEWER MAINTENANCE
4. PLACARD SHALL BE PLACED IN THE UPSTREAM CLEANOUT BOX CLOSEST TO THE HOUSE WARNING PLUMBERS OF THE EXTENDABLE BACKWATER VALVE
5. VALVE AND CLEANOUT ACCESS BOX SHALL BE CHRISTY G05 OR APPROVED EQUAL. SEE NOTE 2 ON DETAIL 9

BACKFLOW PREVENTER DEVICE

DETAIL **10**

DR. BY: ED
 DATE: 08/30/2017

CK. BY: FQ
 DATE: 10/20/2017

APPROVED. BY:

DATE: 10/25/2017